



Interoffice Memorandum

November 8, 2019

TO: Mayor Jerry L. Demings  
and Board of County Commissioners

FROM: Diana M. Almodovar, P.E., Interim Director, Public Works Department 

CONTACT PERSON: Christine N. Lofye, P.E., Manager   
Traffic Engineering Division

PHONE NUMBER: (407) 836-7891

SUBJ: **Installation of "No Parking" signs on Citruswood Drive within the Enclave at Moss Park Community**

Citizens within the Enclave at Moss Park community have expressed concerns related to the ability of emergency vehicles to access their homes when vehicles are parked on both sides of the street.

The Fire Rescue Department has confirmed that allowing parking on both sides of the street impedes emergency apparatus from accessing certain portions of the community, thereby creating a public safety hazard.

Florida Fire Prevention Code, Section 18.2.3.4.1.1, requires that fire department access roads shall have an unobstructed width of no less than twenty (20) feet. In addition, the Florida Fire Prevention Code, Section 18.2.4.1.1, states that the required width of a fire department access road shall not be obstructed in any manner, including the parking of vehicles.

The Fire Marshal recommends the Board approve the installation of "No Parking" signs on both sides of Citruswood Drive within the Enclave at Moss Park community to ensure safe access of emergency vehicles.

**Action Requested: Approval of "No Parking" signs installation on Citruswood Drive within the Enclave at Moss Park Community. District 4.**

DMA/CNL/FY


Attachments

**SIGN LEGEND**



**NOT TO SCALE**

# Location Map

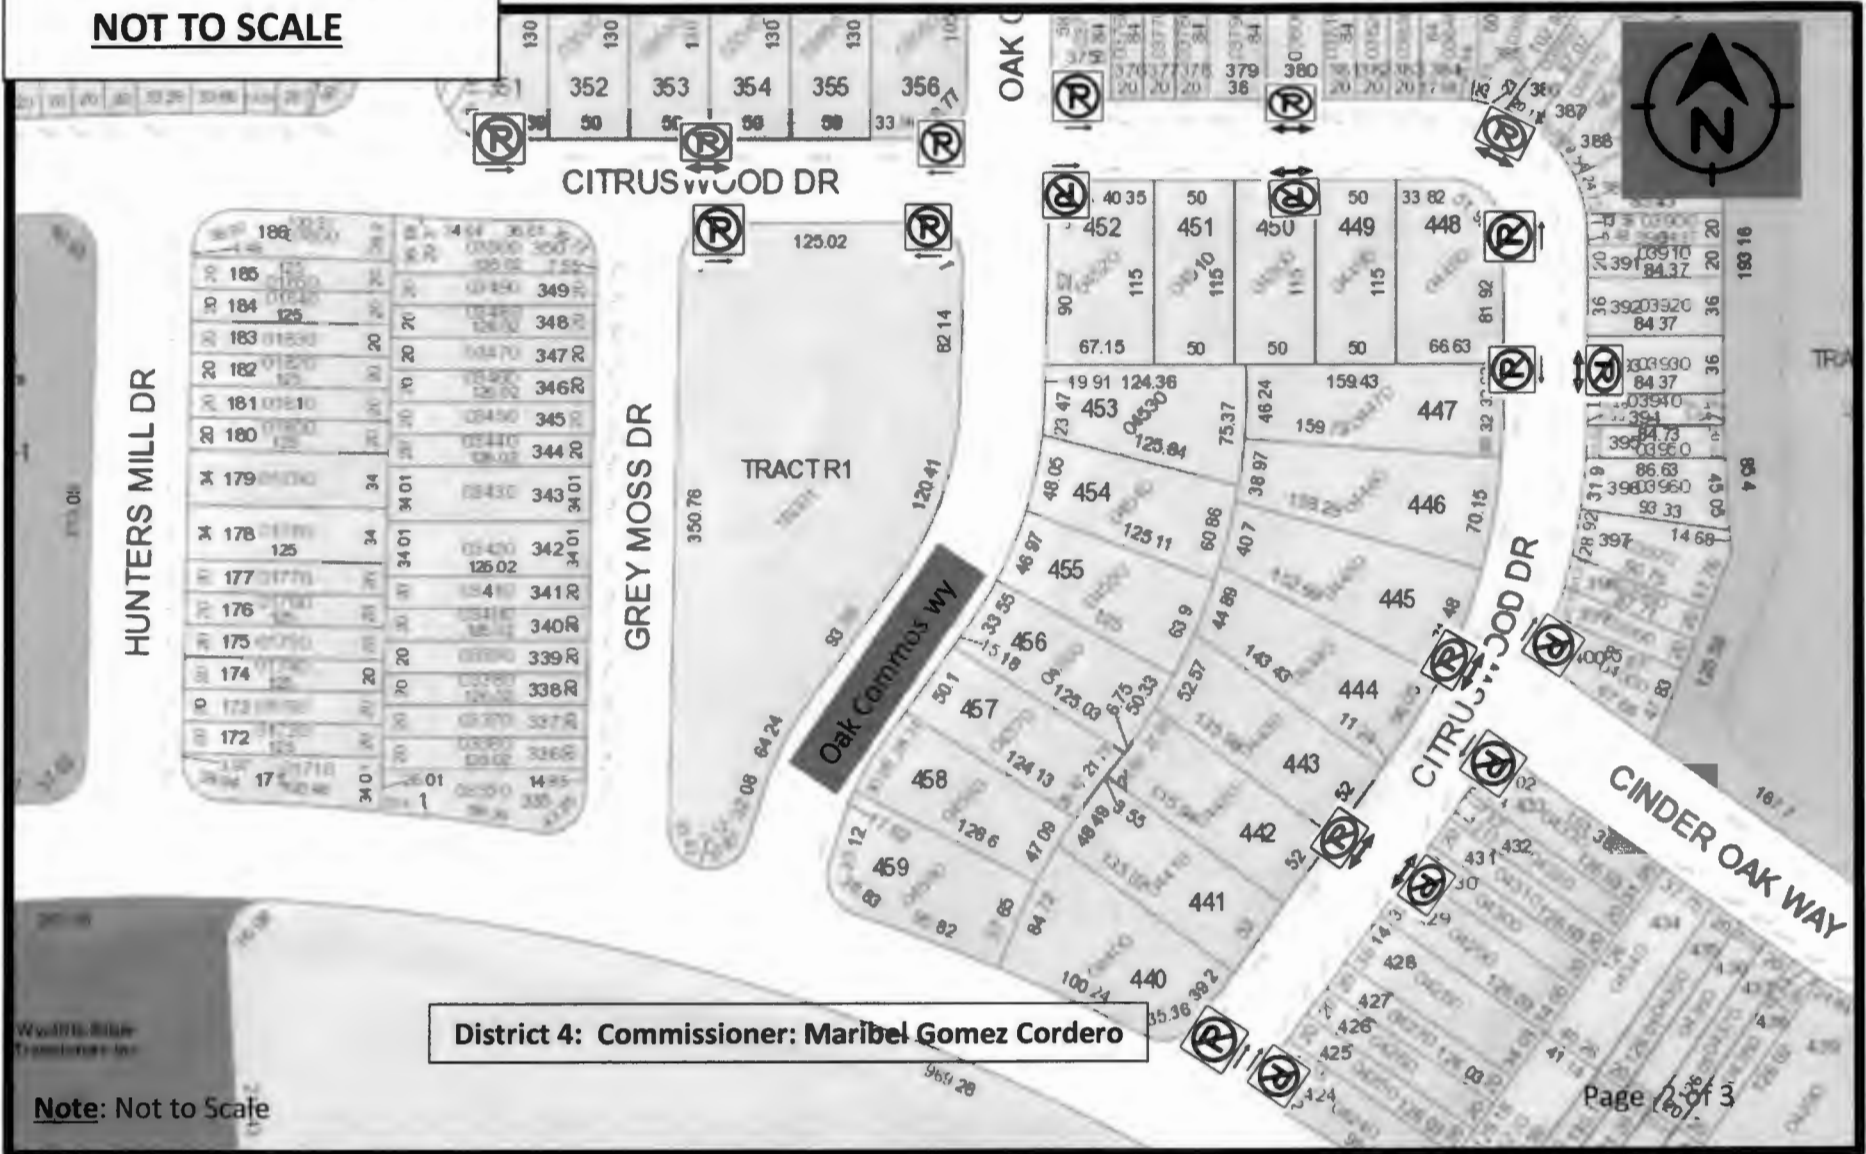

**District 4: Commissioner: Maribel Gomez Cordero**

**Note:** Not to Scale

# District Map

