


Michael Schulte

CDR-25-06-146




High-Voltage
Powerlines

MCO Airport is Close by

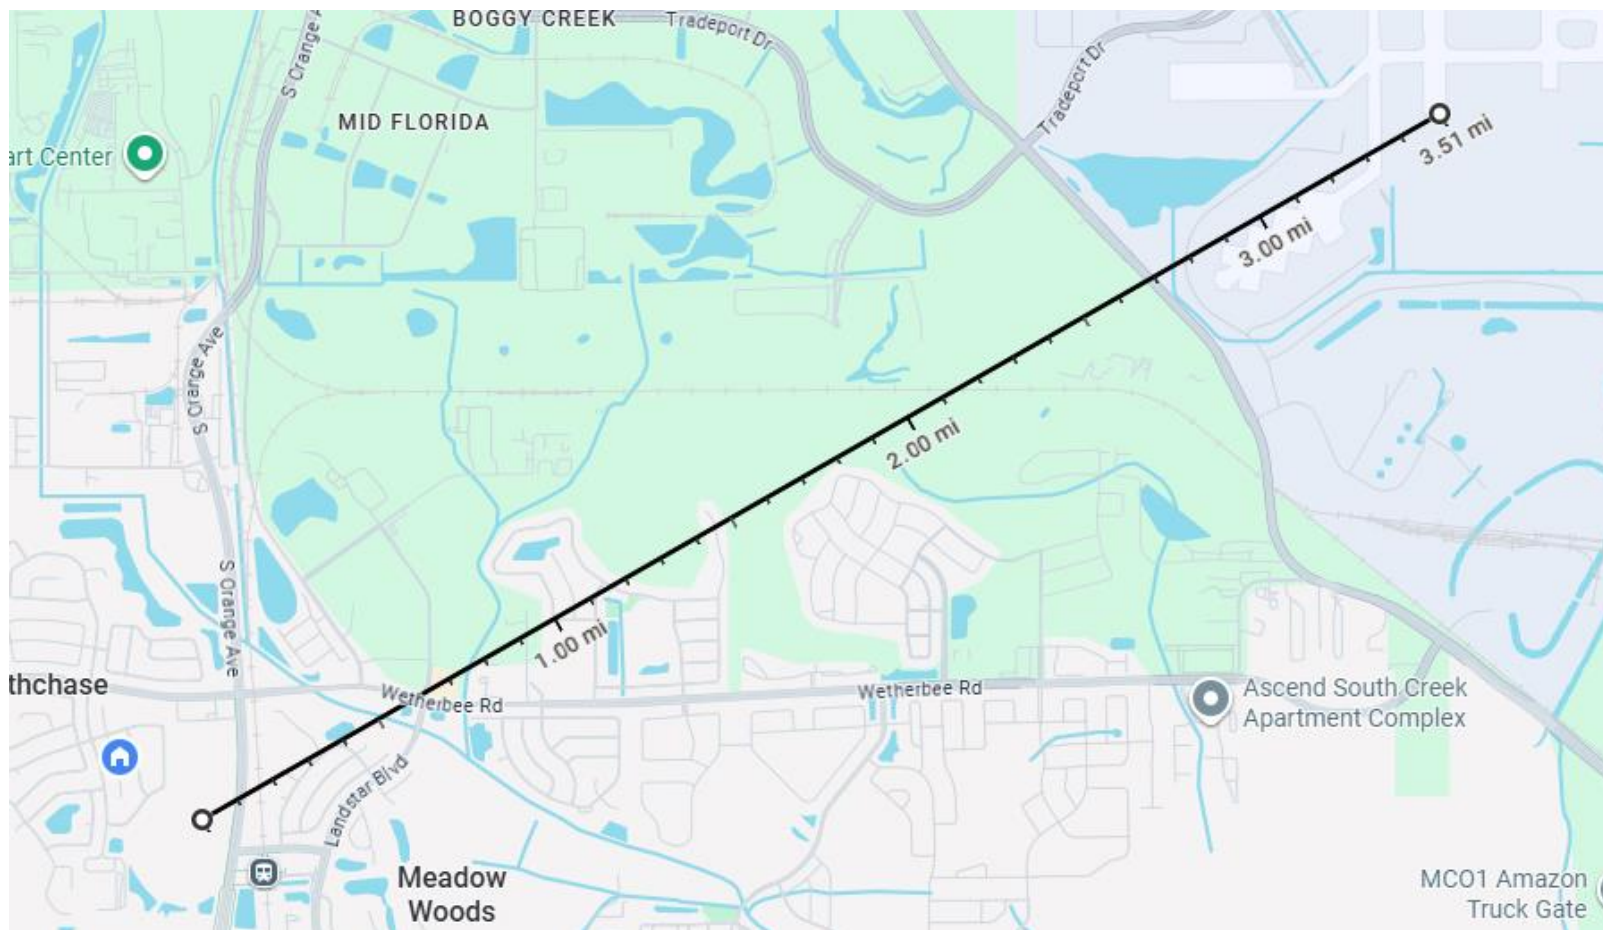


Helicopter Approach

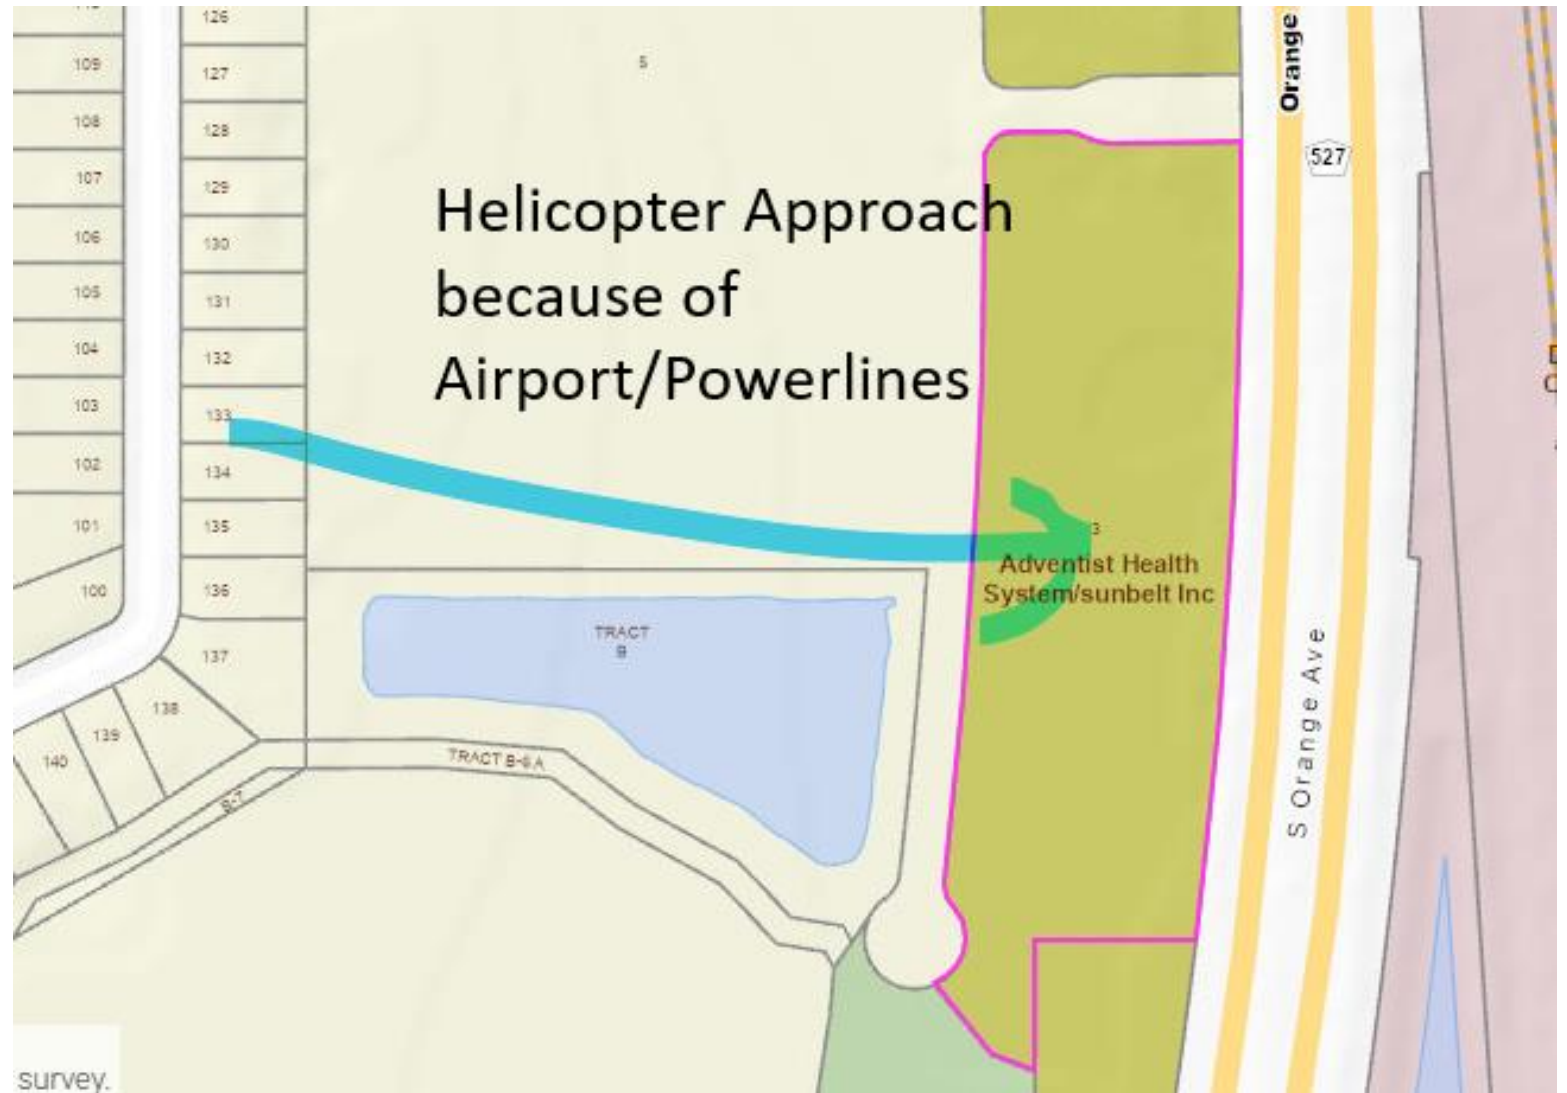

Helipad's Nearby

- To the North 9.41 Miles Orlando Health Regional Medical Center level 1 trauma
- To the South 3.54 Miles Orlando Health Emergency Room and Medical Pavillion

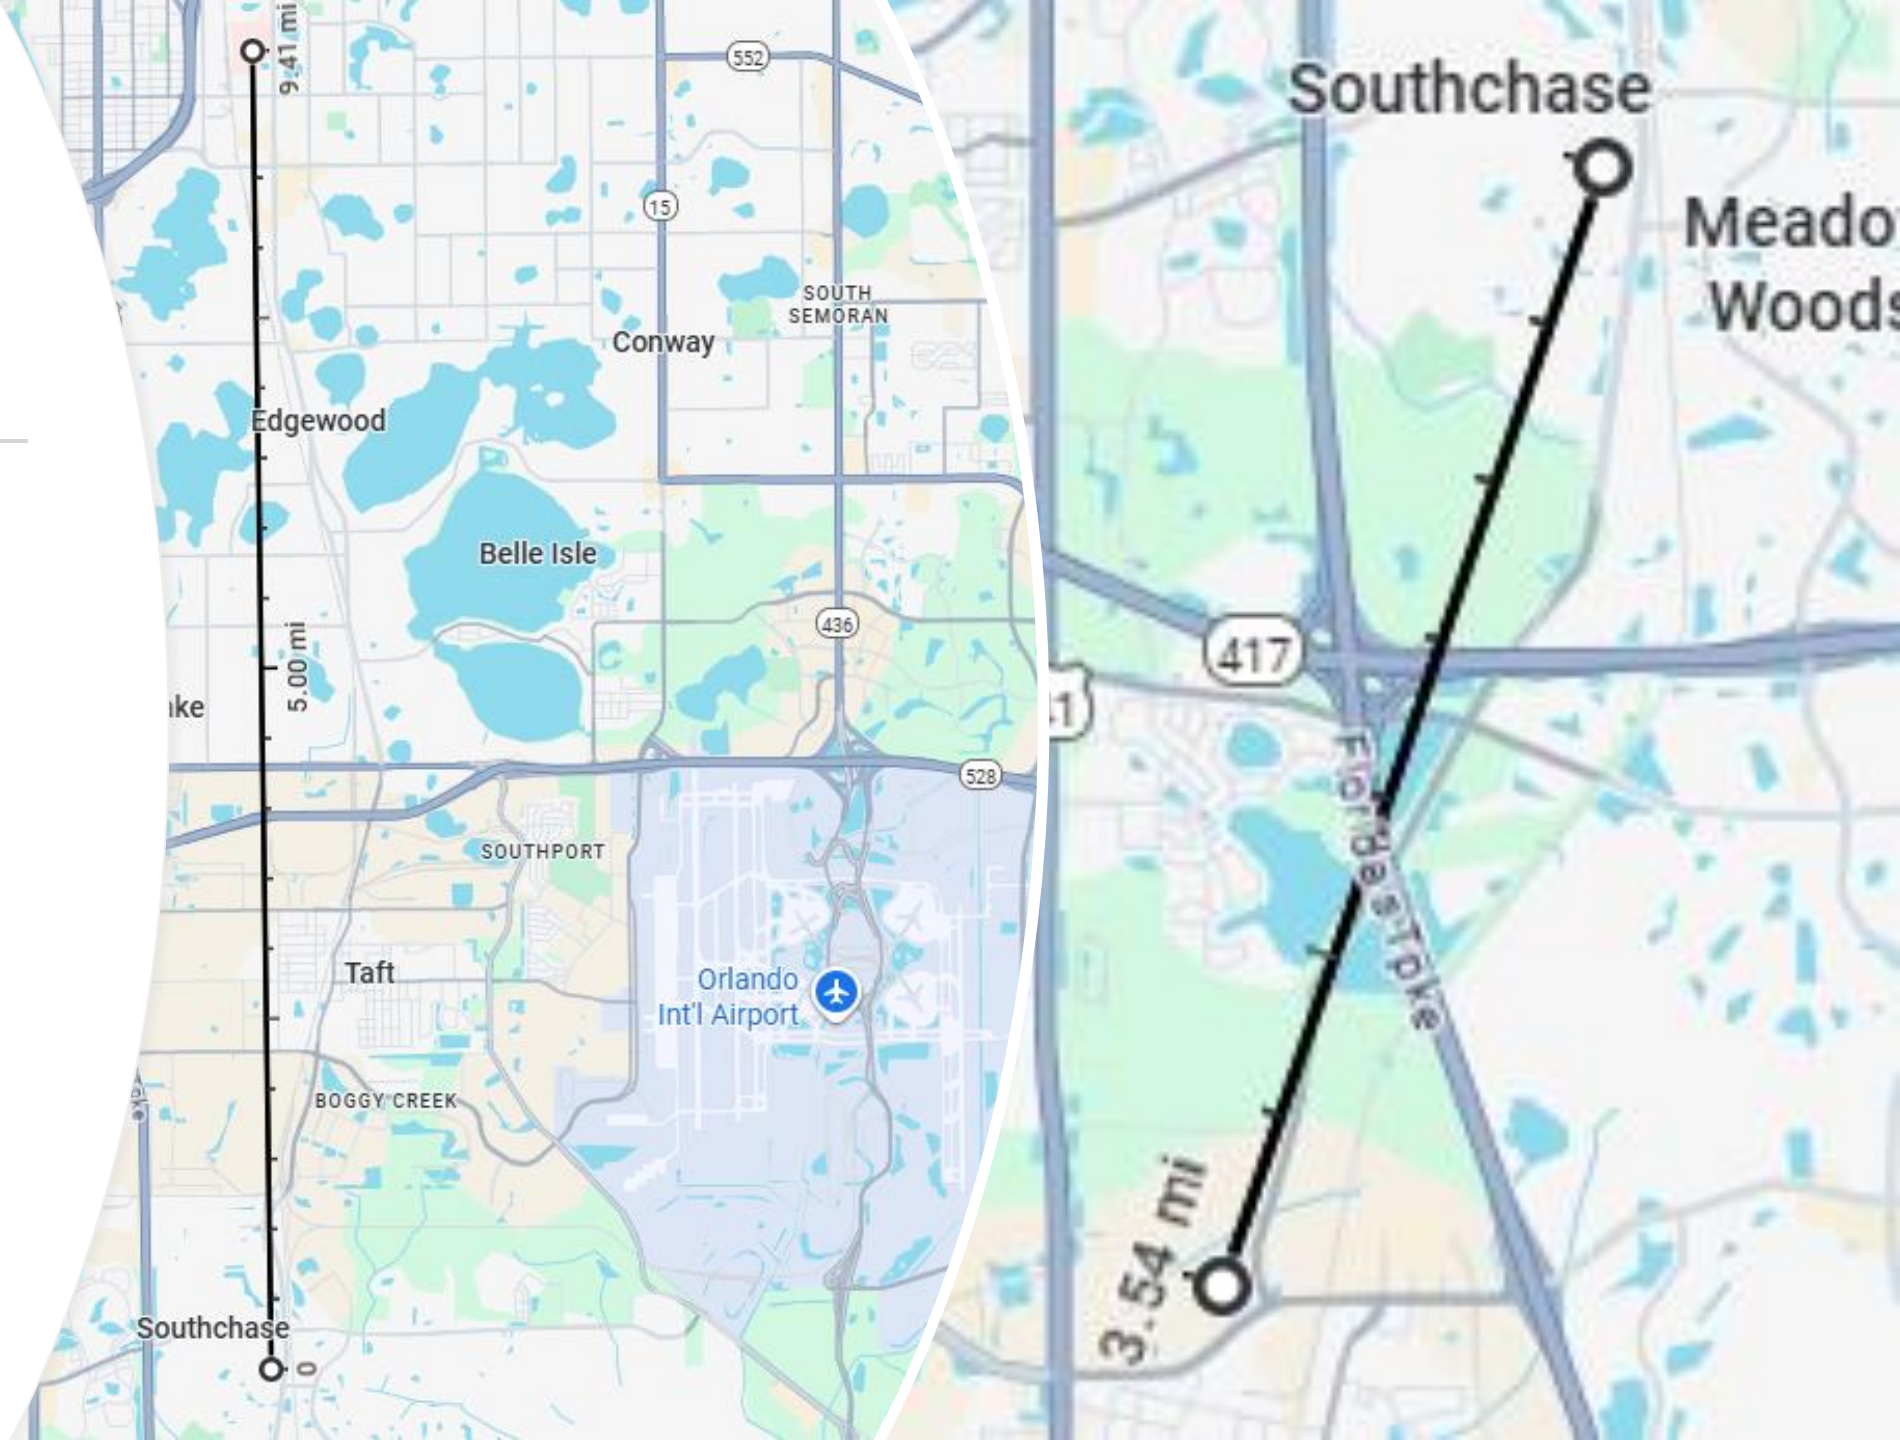

Conclus
ion

Against the
CDR-25-06-
146

Thank you
for your
time.