


# Eastern Water Reclamation Facility

Angela Emerson





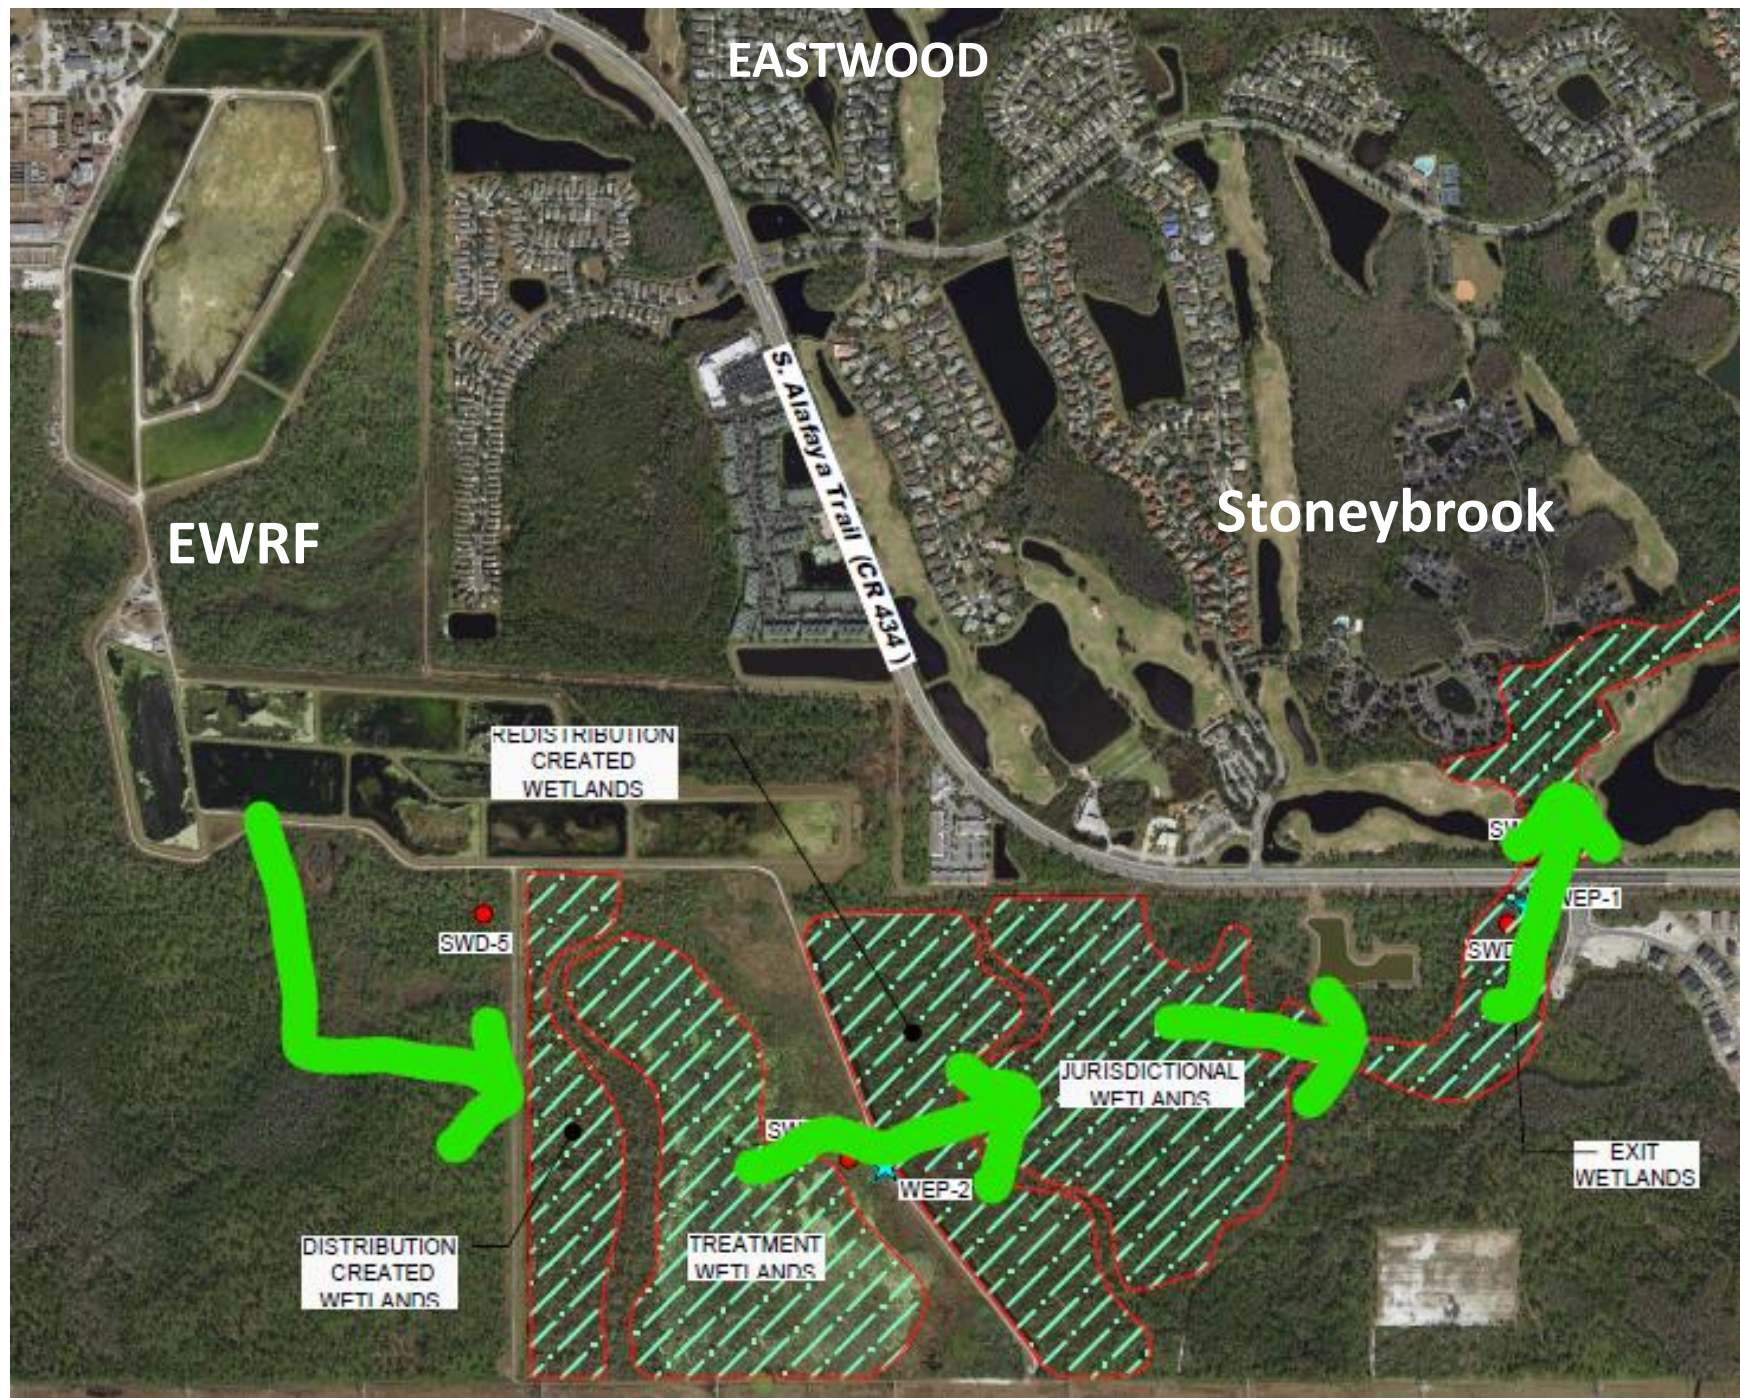

*Historically, Curtis Stanton Energy Center (SEC) has received the largest share of Eastern Water Reclamation Facility's effluent flow. In the past few years SEC's **demand for EWRFs reclaimed water has declined** as SEC turned to more green energy sources. **EWRF's remaining effluent flows are too large for the capacity of the existing PAR system.** Therefore, EWRFs only alternative must be **discharged into Wetlands (FLW-4).***



## IMPORTANT INFORMATION ABOUT YOUR DRINKING WATER

Monitoring Requirement for  
Eastern Regional Water System — Water System ID 3424132  
Western Regional Water System — Water System ID 3421546  
Daetwyler Shores — Water System ID 3420285

We are required to monitor your drinking water for specific contaminants on a regular basis. Results of regular monitoring are an indicator of whether or not your drinking water meets health standards. During November 2022, we did not monitor or test for total coliforms, and therefore cannot be sure of the quality of your drinking water during that time. Specifically on November 8, 2022, a batch of samples for total coliforms was not properly processed. Orange County Utilities sampled in December to ensure compliance with Florida Department of Environmental Protection (FDEP) methods. Total coliform bacteria are generally not harmful themselves. Coliforms are bacteria that are naturally present in the environment and are used as an indicator that other, potentially harmful bacteria may be present.

To boil your water or use an alternative water source, please see the notice distributed on November 15, 2022.

Recent Drinking water notice



